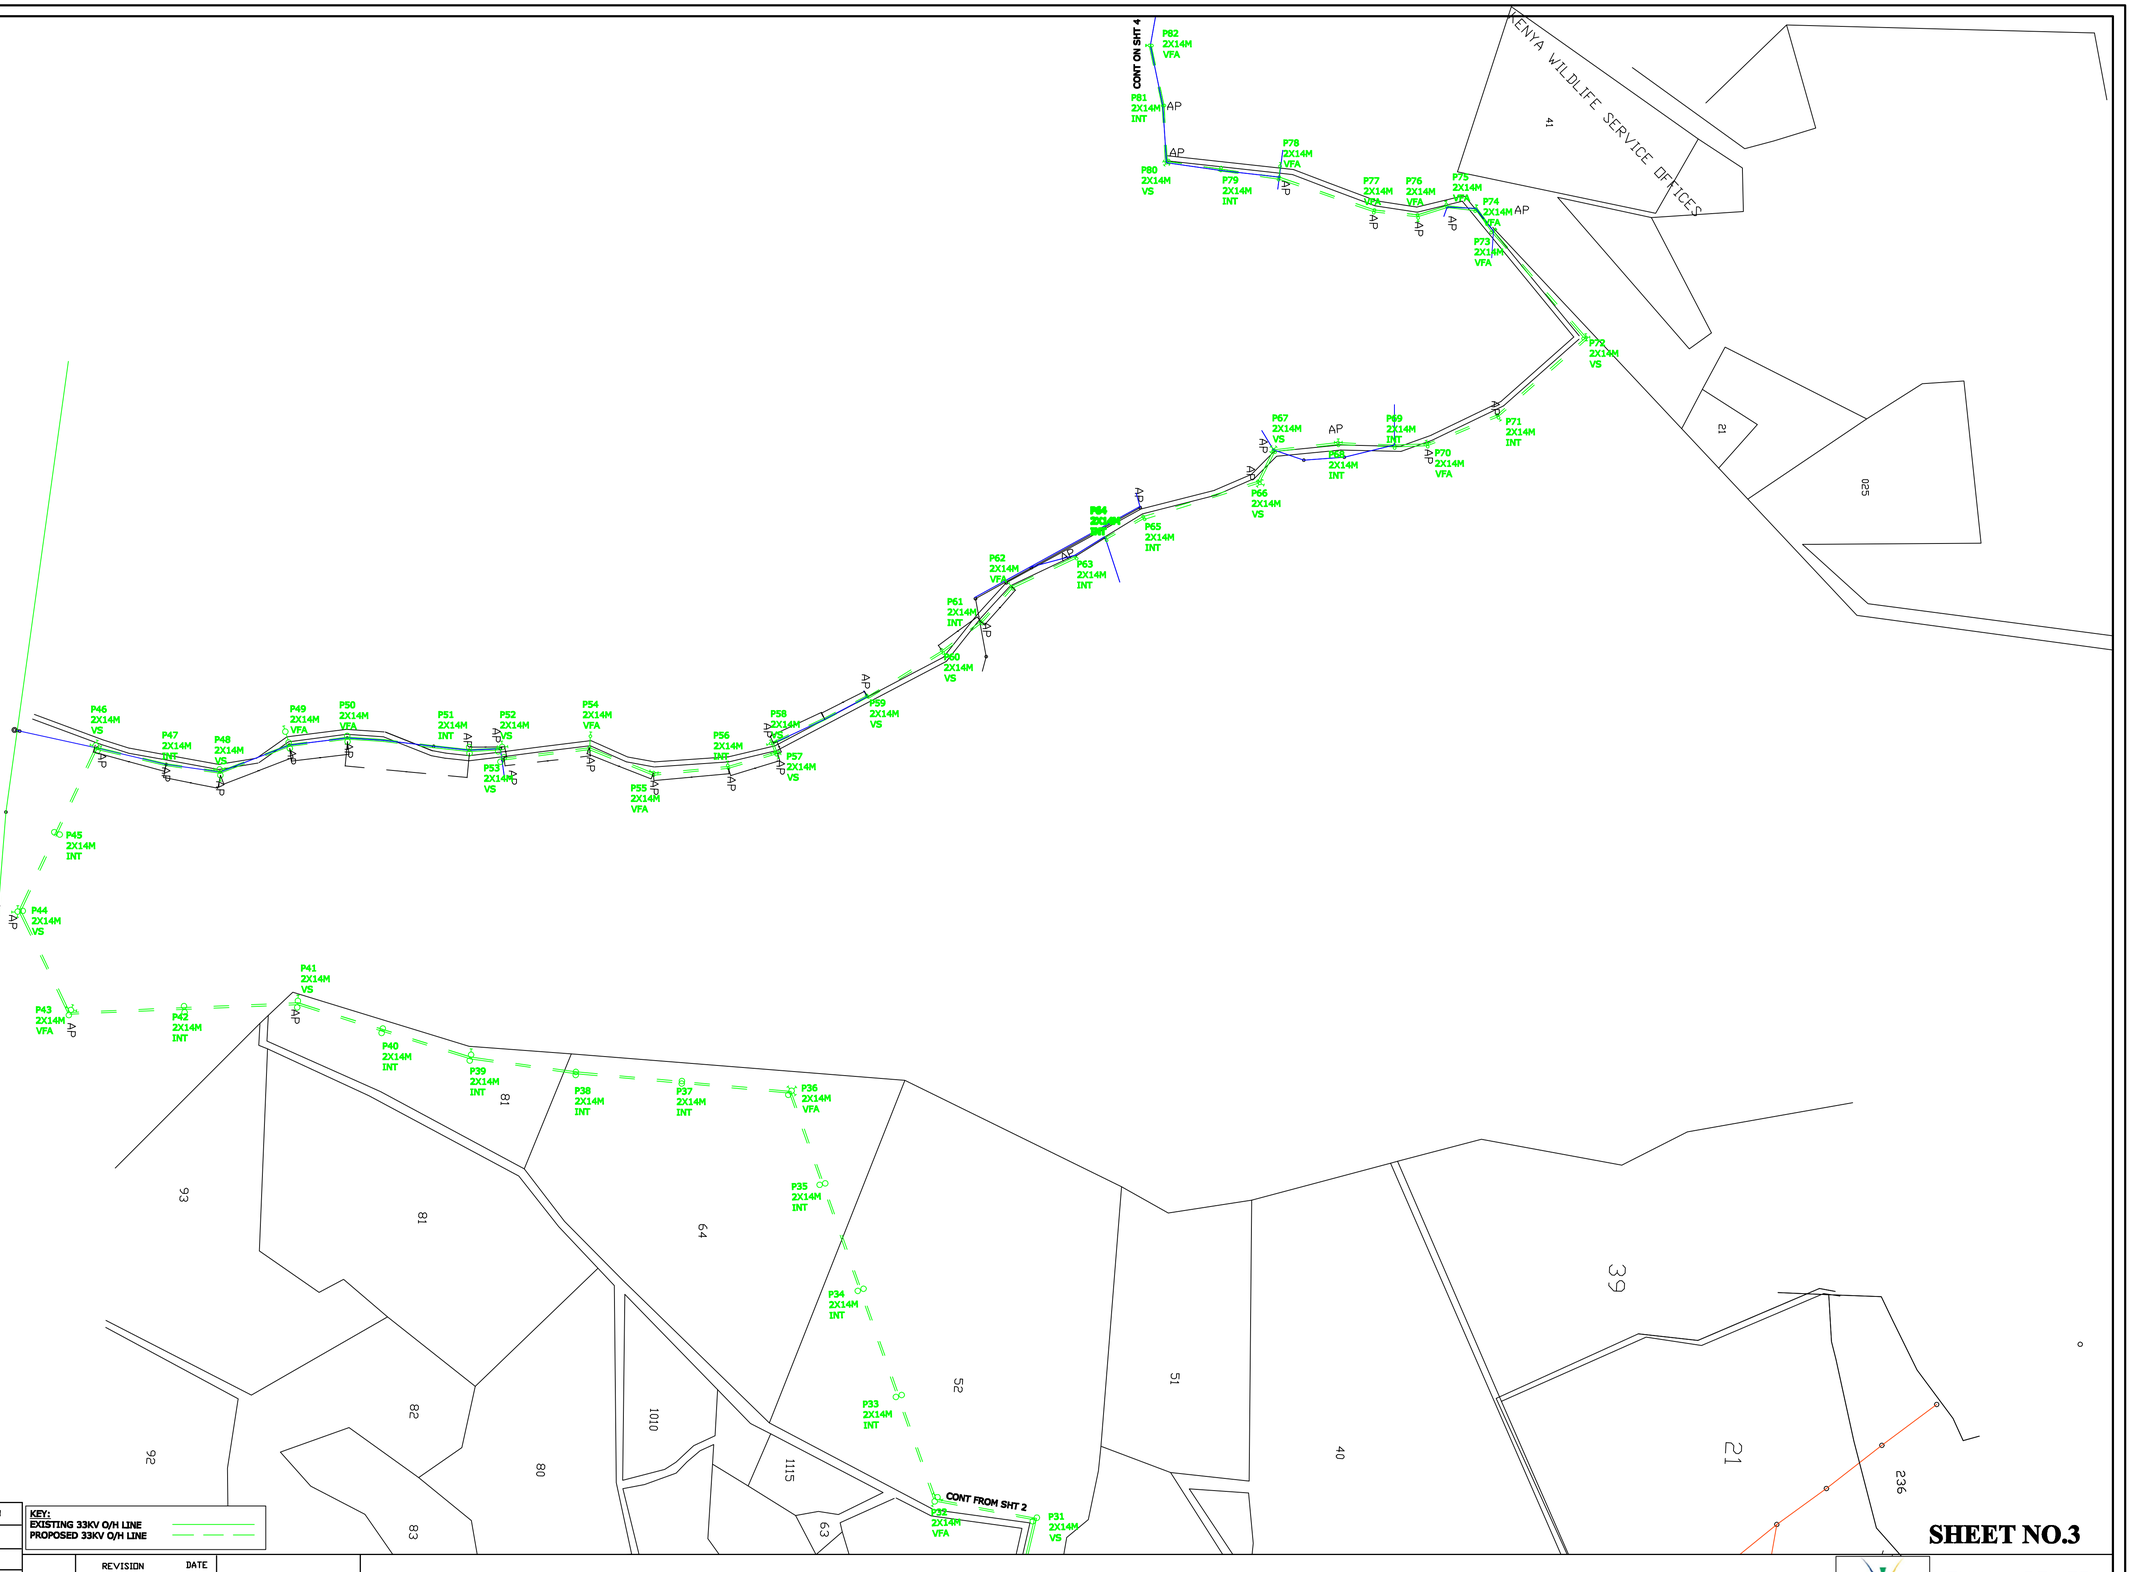

APPROVED	DATE	NAME	SIGN
CHECKED ENGINEER,PC		KAMAU	
CHECKED PRINCIPAL DMAN		LOBARO	
CHECKED SURVEYOR		S.OTIENO	
CHECKED PRINCIPA SURVEYOR		MUIA	
DRAWN	JULY 2014	REBECCA	

KEY:
EXISTING 33KV O/H LINE
PROPOSED 33KV O/H LINE

	REVISION	DATE
1		
2		
3		
4		
5		
6		

PROPOSED KABARNET 132/ 33KV FEEDOUTS

SCALE: 1; 2500

KENYA POWER

SHEET NO.3

SK. No. 11182