



Kenya Power

TITLE:

**SPECIFICATION FOR
PORTABLE EARTHING
EQUIPMENT FOR
OVERHEAD LINES (UP
TO 66KV)**

Doc. No.	KP1/3CB/TSP/09/007
Issue No.	2
Revision No.	0
Date of Issue	2012-05-30
Page 1 of 13	

TABLE OF CONTENTS

0.1 Circulation List

0.2 Amendment Record

FOREWORD

1. SCOPE
2. REFERENCES
3. TERMS AND DEFINITIONS
4. REQUIREMENTS
5. TESTS AND INSPECTION
6. INSTRUCTIONS, MARKING AND PACKING

ANNEX A: Guaranteed Technical Particulars *(to be filled and signed by the Supplier and submitted together with copies of the manufacturer's catalogues, brochures, technical data, customer sales records & reference letters and quality certificates for tender evaluation)*

Issued by: Head of Section, Tech Stds & Specs

Authorized by: Head of Department , R & D

Signed:

Signed:

Date: 2012-05-30

Date: 2012-05-30



TITLE:

**SPECIFICATION FOR
PORTABLE EARTHING
EQUIPMENT FOR
OVERHEAD LINES (UP
TO 66KV)**

Doc. No.

KP1/3CB/TSP/09/007

Issue No.

2

Revision No.

0

Date of Issue

2012-05-30

Page 2 of 13

0.1 Circulation List

COPY NO.	COPY HOLDER
1	Research & Development Manager
2	Procurement Manager
Electronic copy (pdf) on Kenya Power Server (currently :Network-\\stima-fprnt-001\techstd&specs	

0.2 Amendment Record

Rev No.	Date (YYYY-MM-DD)	Description of Change	Prepared by (Name & Signature)	Approved by (Name & Signature)
Issue 2	2012-05-30	Cancels and replaces TSP-09-007 1 st Issue Rev 0 dated May 2005	S. Kimitei <i>[Signature]</i>	G. K. Gathige <i>[Signature]</i>

Issued by: Head of Section, Tech Stds & Specs

Authorized by: Head of Department , R & D

Signed:

[Signature]

Signed:

[Signature]

Date: 2012-05-30

Date: 2012-05-30



Kenya Power

TITLE:

**SPECIFICATION FOR
PORTABLE EARTHING
EQUIPMENT FOR
OVERHEAD LINES (UP
TO 66KV)**

Doc. No.	KP1/3CB/TSP/09/007
Issue No.	2
Revision No.	0
Date of Issue	2012-05-30
Page 3 of 13	

FOREWORD

This specification has been prepared by the Research and Development Department of The Kenya Power and Lighting Company Limited (Kenya Power) and it lays down requirements for Portable Earthing Equipment used for temporary earthing on 66kV, 33kV and 11kV overhead lines. It is intended for use by Kenya Power in purchasing Portable Earthing Equipment used for temporary earthing on 66kV, 33kV and 11kV overhead lines.

It shall be the responsibility of the supplier to ensure adequacy of the design and good engineering practice in the manufacture of the Portable Earthing Equipment for Kenya Power. The supplier shall also submit information which confirms satisfactory service experience with products which fall within the scope of this specification.

1. SCOPE

- 1.1 This standard specifies requirements for Portable Earthing Equipment used as Circuit Main Earths (CME) or Additional Earths on 66kV, 33kV and 11kV overhead lines operating at 50Hz.
- 1.2 The specification covers the following:
- a) Portable Earthing Equipment with Copper Leads
 - b) Portable Earthing Equipment with Aluminium Leads

Note: The type required shall be specified for each Tender.

2. REFERENCES

The following standards contain provisions which, through reference in this text, constitute provisions of this specification. Unless otherwise stated, the latest edition of the referenced documents (including any amendments) applies.

IEC 61230: Live working – Portable Equipment for Earthing or Earthing and Short-circuiting.

IEC 61138: Cables for Portable Earthing and Short-circuiting Equipment

BS 7454: Method for calculation of thermally permissible short circuit currents, taking into account non-adiabatic heating effects.

Issued by: Head of Section, Tech Stds & Specs


Authorized by: Head of Department, R & D

Signed:

Signed:

Date: 2012-05-30

Date: 2012-05-30



TITLE:

**SPECIFICATION FOR
PORTABLE EARTHING
EQUIPMENT FOR
OVERHEAD LINES (UP
TO 66KV)**

Doc. No.

KP1/3CB/TSP/09/007

Issue No.

2

Revision No.

0

Date of Issue

2012-05-30

Page 4 of 13

3. TERMS AND DEFINITIONS

For the purpose of this specification, the definitions given in the reference standards shall apply.

4. REQUIREMENTS

4.1 Service Conditions

The equipment shall be suitable for continuous outdoor operation in tropical areas at altitudes of 2200m above sea level, humidity of upto 90%, average ambient temperature of +30°C with a minimum of -1°C and a maximum of +40°C and heavy saline conditions along the coast.

4.2 General Requirements

4.2.1 The portable earthing equipment shall be designed and manufactured in accordance with IEC 61230 and IEC 61138 and shall permit safe earthing of electrical installations.

4.2.2 The portable earthing equipment shall be supplied as a complete kit comprising earth-end clamp, line-end clamp and flexible leads complete with terminations.

4.2.3 After application of the earth-end clamp to the appropriate earth connection, the equipment shall be suitable for application of the line-end clamps in turn by means of non-conducting operating rod to the overhead line conductors.

Note: The operating socket used in the company is of the form shown in fig 2 and is procured with the operating rod separately.

4.2.4 The design of the equipment shall include a separate 'star-point' connection device between the earth lead and phase leads. This 'star-point' connection device shall be provided with a means of supporting the weight of the complete assembly by attachment to the line support, adjacent to the position adopted by the operator, before the application of the line-end clamps.

4.2.5 The method of coupling the operating rod to the line-end clamps shall permit the application of the clamp to the line conductor from an angle of between 45 –90° to the axis of the conductor.

4.2.6 The complete equipment shall withstand the maximum expected short circuit fault current during the selected fault time.

Issued by: Head of Section, Tech Stds & Specs

Authorized by: Head of Department , R & D

Signed:

Signed:

Date: 2012-05-30

Date: 2012-05-30



TITLE:

**SPECIFICATION FOR
PORTABLE EARTHING
EQUIPMENT FOR
OVERHEAD LINES (UP
TO 66KV)**

Doc. No.	KP1/3CB/TSP/09/007
Issue No.	2
Revision No.	0
Date of Issue	2012-05-30
Page 5 of 13	

For 66kV, 33kV and 11kV overhead lines, this current is 13kA for 1 sec.

4.2.7 The equipment shall be able to withstand all stresses from the specified fault currents without causing electrical, mechanical, chemical or thermal danger to persons.

4.2.8 All the components shall be resistant to the levels of corrosion and physical handling stresses expected in service.

4.3 Earth End Clamp

4.3.1 The earth end clamp shall comprise:

(a) A device for making electrical contact with the earth connection point i.e. earth rod assembly or steel work as appropriate.

(b) Operating screw for tightening (by hand) the device to the earth connection point.

(c) A termination separate from the arrangement given in item 4.3.1(b) for attaching the protective conductor to the device given in item 4.3.1 (a).

4.3.2 The clamp shall be rated for 13kA 1 sec and shall be of the general shape and material details given in fig 1.

4.3.3 The torque necessary to complete the connection shall not exceed 22 Nm and the clamp shall be capable of withstanding over-tightening up to a maximum torque of 45 Nm without damage to the clamp or conductor.

4.4 Line End Clamp

4.4.1 The line end clamp shall comprise:

(a) A device for making electrical contact with the overhead conductor.

(b) Operating screw for tightening the device on to the conductor. The operating screw shall be tightened by means of operating socket fitted to the fibre glass operating pole.

(c) Once hooked over the conductor, the clamp shall become self supporting whilst the operating screw is tightened or loosened.

(d) A termination separate from the arrangement given in item 4.4.1(b) for attaching the protective conductor to the device given in item 4.4.1(a).

Issued by: Head of Section, Tech Stds & Specs

Authorized by: Head of Department , R & D

Signed:

Signed:

Date: 2012-05-30

Date: 2012-05-30



Kenya Power

TITLE:

SPECIFICATION FOR PORTABLE EARTHING EQUIPMENT FOR OVERHEAD LINES (UP TO 66KV)

Doc. No.

KP1/3CB/TSP/09/007

Issue No.

2

Revision No.

0

Date of Issue

2012-05-30

Page 6 of 13

4.4.2 Each line-end clamp shall be suitable for connection to aluminium multi-stranded line conductor in both new and oxidized conditions of diameters 6-20mm and copper bus-bar tubes of 38mm diameter. The clamps shall be suitable for connection to both tension and non-tension conductors.

4.4.3 The design of the clamp shall be such that its attachment to the conductor does not result in the inevitable deformation of the later. It shall slide smoothly onto the overhead conductor.

4.4.4 The torque necessary to complete the connection shall not exceed 22 Nm and the clamp shall be capable of withstanding over-tightening up to a maximum torque of 45 Nm without damage to the clamp or conductor.

4.4.5 The clamp shall be rated for 13KA for 1 sec and shall be of the general shape and material details given in fig 3.

4.5 Flexible Cable with terminations

4.5.1 General Requirements

The cable shall be of low weight and flexible over a wide range of temperature.

The insulating covering shall offer protection against mechanical and chemical damage.

The earthing and short-circuiting cables shall withstand a fault current of 13KA for 1 sec.

4.5.2 Construction

The cable shall be manufactured in accordance with IEC 61138.

The covering of the cable shall be based on a compound of thermoplastic polyvinyl chloride suitable for indoor and outdoor use within -5°C to 70°C in accordance with IEC 61138. The mean value of the thickness of the covering shall be not less than 1.8mm.

a) Type 1: Copper

The conductor shall consist of annealed copper tinned wires. The maximum diameter and electrical resistance (at 20°C) of the conductor wires shall be 0.21mm and 0.277ohm/km respectively (in accordance with IEC 61138).

Issued by: Head of Section, Tech Stds & Specs

Authorized by: Head of Department , R & D

Signed:

Signed:

Date: 2012-05-30

Date: 2012-05-30



TITLE:

**SPECIFICATION FOR
PORTABLE EARTHING
EQUIPMENT FOR
OVERHEAD LINES (UP
TO 66KV)**

Doc. No.

KP1/3CB/TSP/09/007

Issue No.

2

Revision No.

0

Date of Issue

2012-05-30

Page 7 of 13

Copper Cables for use in overhead lines (66kV, 33kV, 11kV) portable earthing equipment shall be 70mm² in cross sectional area and 13.9mm overall conductor diameter.

b) Type 2: Aluminium

The flexible lead shall be manufactured from fine stranded commercially pure aluminium sheathed with clear PVC. The maximum diameter and electrical resistance (at 20°C) of the conductor wires shall be 0.46mm and 0.326ohm/km respectively (in accordance with IEC 61138).

Aluminium Cables for use in overhead lines (66kV, 33kV, 11kV) portable earthing equipment shall be 95mm² in cross sectional area and 17mm overall conductor diameter.

4.5.3 Terminations

The cables shall be supplied complete with terminations ready for connection to line end and earth end clamps by use of single bolts.

Excellent fatigue resistance is required for the connections of cables to clamps and connecting cluster ('star-point'). The terminations used shall obviate fraying of conductor strands and wear on protective PVC insulation and shall be fitted with transparent heatshrink flexible sleeves to provide additional support (design as per fig 4, for aluminium, similar design for copper cables).

The connections shall ensure that the specified minimum characteristic of the cable are maintained. Terminal lugs shall be supplied fully compressed onto the leads.

5. TESTS AND INSPECTION

5.1 The complete earthing kit shall be tested according to the requirements of IEC 61230. The earthing and short circuiting cables shall be tested in accordance with IEC 61138. It shall be the responsibility of the manufacturer to perform or to have performed all the tests specified.

5.2 Copies of previous test certificates and test reports shall be submitted together with other bid documents for tender evaluation. The test report shall be from ISO/IEC 17025 accredited testing laboratory.

Issued by: Head of Section, Tech Stds & Specs

Authorized by: Head of Department , R & D

Signed:

Signed:

Date: 2012-05-30

Date: 2012-05-30



Kenya Power

TITLE:

**SPECIFICATION FOR
PORTABLE EARTHING
EQUIPMENT FOR
OVERHEAD LINES (UP
TO 66KV)**

Doc. No.

KP1/3CB/TSP/09/007

Issue No.

2

Revision No.

0

Date of Issue

2012-05-30

Page 8 of 13

5.3 Upon completion of manufacturing process, the equipment shall be inspected by two Kenya Power Engineers at place of manufacture and sample tests carried out in their presence before shipment.

Routine and Sample Test Reports shall be completed and submitted to the purchaser Kenya Power for approval before shipment of the equipment.

5.4 The purchaser (Kenya Power) shall perform or have performed any of the specified tests to confirm compliance of the received equipment with the specifications before acceptance to stores. The supplier shall replace any portable earthing equipment that fails any of the inspection/test at stores or when used in the field.

6.0 INSTRUCTIONS, MARKING AND PACKING

6.1 Instruction for use shall be included in each package (all in English Language).

6.2 Each component shall be marked with the following markings:

a) Manufacturer's name or trade mark.

b) Model or type reference number for the device.

c) Cross-section in mm², material and a double triangle symbol at 1m intervals on each cable.

d) Year of manufacture.

e) Rated current I_r (kA r.m.s) for rated time t_r (s) of the device (example 13kA/1s).

f) The words 'PROPERTY OF KPLC' (Note: Authority to use this inscription shall be given together with the approval for design drawings before manufacture.

6.3 Markings shall be clearly legible, durable and consist of letters at least 3mm high. All markings shall be in the English Language.

6.4 The portable earthing equipment shall be supplied packed in a carrying case made of strong and durable canvas material or better.

Issued by: Head of Section, Tech Stds & Specs


Authorized by: Head of Department , R & D

Signed:

Signed:

Date: 2012-05-30

Date: 2012-05-30

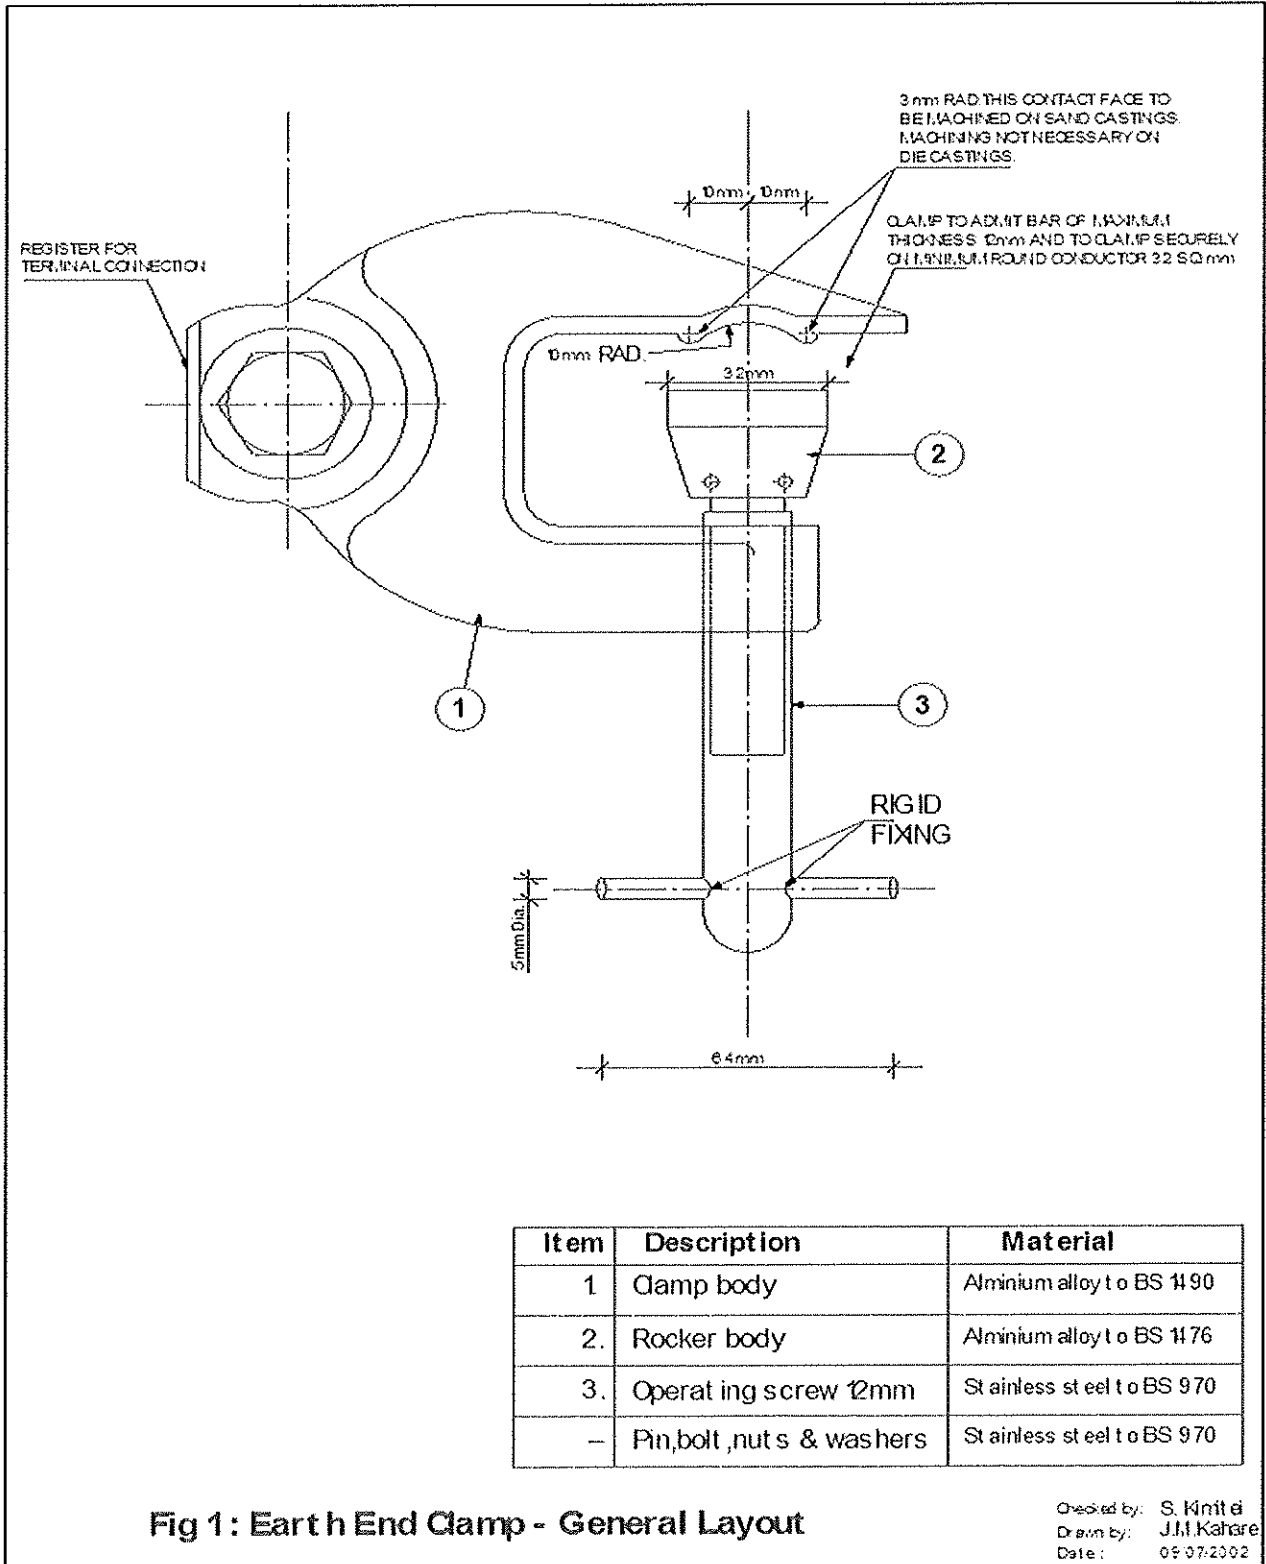

Issued by: Head of Section, Tech Stds & Specs

Authorized by: Head of Department, R & D

Signed: *[Signature]*

Signed: *[Signature]*

Date: 2012-05-30

Date: 2012-05-30



TITLE:

**SPECIFICATION FOR
PORTABLE EARTHING
EQUIPMENT FOR
OVERHEAD LINES (UP
TO 66KV)**

Doc. No.

KP1/3CB/TSP/09/007

Issue No.

2


Revision No.

0

Date of Issue

2012-05-30

Page 10 of 13

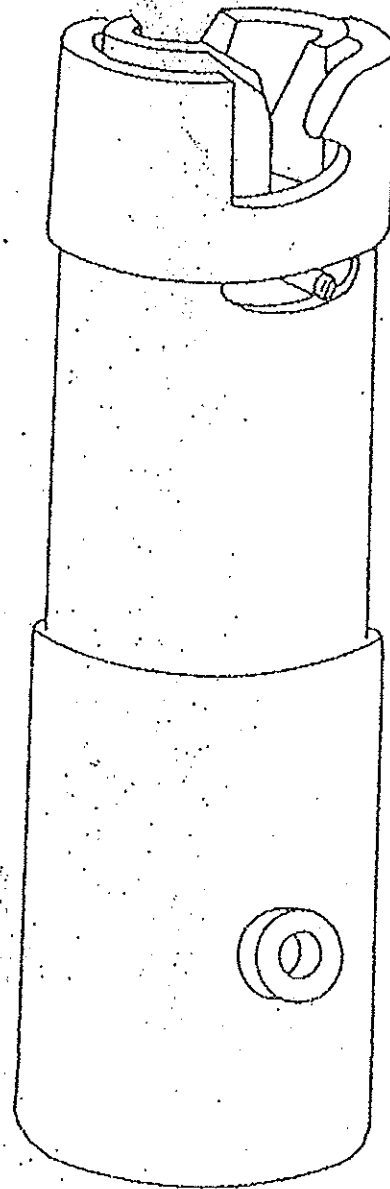

Material

Aluminium alloy
casting with
aluminium insert

Fig 2: General layout of operating head (supplied separately)

Issued by: Head of Section, Tech Stds & Specs

Authorized by: Head of Department , R & D

Signed:

Signed:

Date: 2012-05-30

Date: 2012-05-30


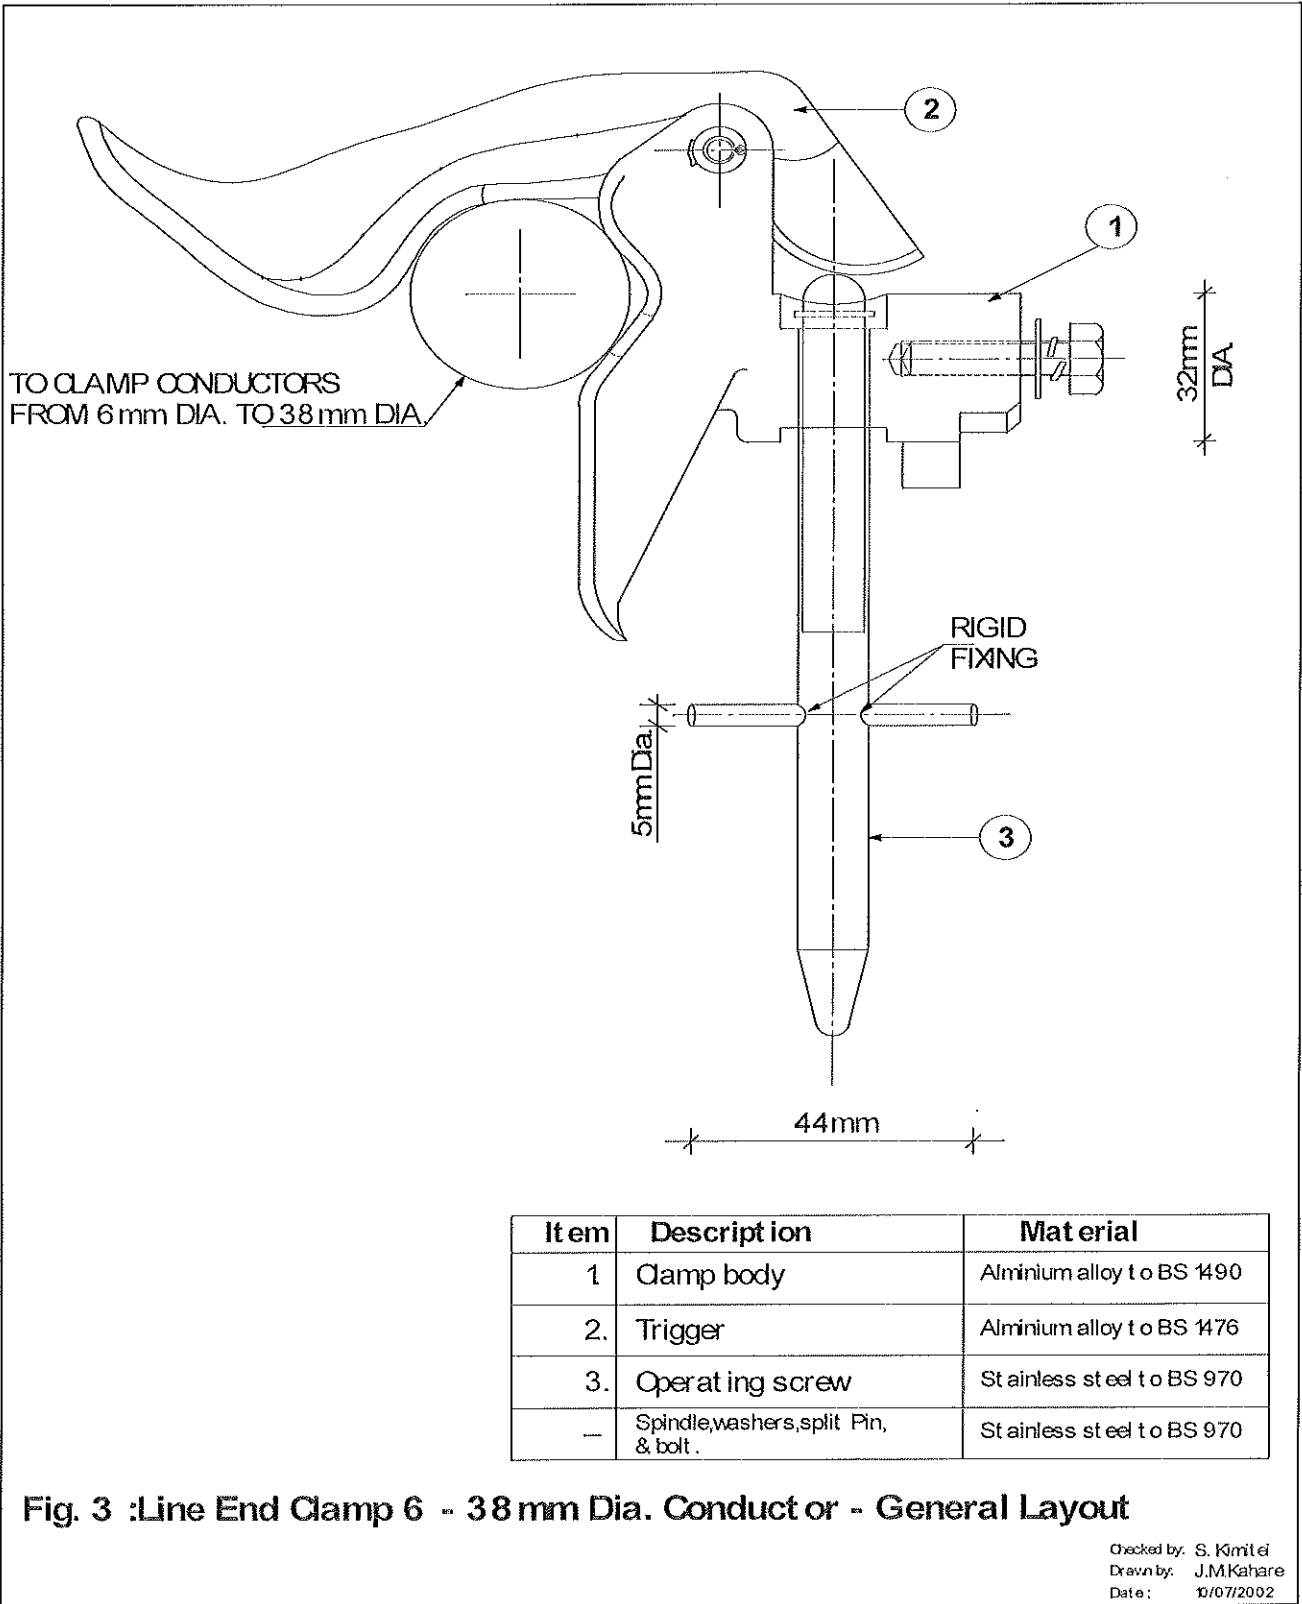


Fig. 3 :Line End Clamp 6 - 38 mm Dia. Conductor - General Layout

Issued by: Head of Section, Tech Stds & Specs

Authorized by: Head of Department, R & D

Signed:



Signed:



Date: 2012-05-30


Date: 2012-05-30



TITLE:
**SPECIFICATION FOR
 PORTABLE EARTHING
 EQUIPMENT FOR
 OVERHEAD LINES (UP
 TO 66KV)**

Doc. No.	KP1/3CB/TSP/09/007
Issue No.	2
Revision No.	0
Date of Issue	2012-05-30
Page 12 of 13	

3 COMPRESSIONS (50 Ton Press or Equivalent)

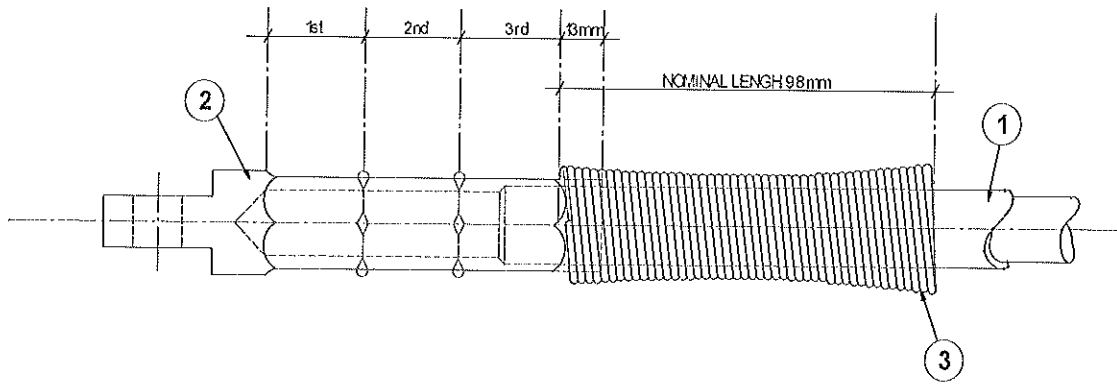

Item	Description	Material
1.	Cable	Commercial pure Aluminium
2.	Fitting	Commercial pure Aluminium
3.	Spring	12SWG Austenitic stainless steel to BS 970

Fig. 4 :Cable Termination - General Configuration

Checked by: S. Kimiti
 Drawn by: J.M. Kahara
 Date: 01/07/2012

Issued by: Head of Section, Tech Stds & Specs


Authorized by: Head of Department, R & D

Signed:

Signed:

Date: 2012-05-30

Date: 2012-05-30



TITLE:

**SPECIFICATION FOR
PORTABLE EARTHING
EQUIPMENT FOR
OVERHEAD LINES (UP
TO 66KV)**

Doc. No.

KP1/3CB/TSP/09/007

Issue No.

2

Revision No.

0

Date of Issue

2012-05-30

Page 13 of 13

ANNEX A: Guaranteed Technical Particulars (to be filled and signed by the Supplier and submitted together with copies of manufacturer's catalogues, brochures, drawings, technical data, sales records and copies of certificates/test reports for tender evaluation)

Tender No.

Clause number	Bidder's offer (indicate full details of the offered equipment for each requirement of the specification)
1. Scope	
1.1	
1.2	
4. Requirements	
4.1 Service Conditions	
4.2 General Requirements	
4.2.1	
4.2.2	
4.2.3	
4.2.4	
4.2.4	
4.2.5	
4.2.6	
4.2.7	
4.2.8	
4.3 Earth End Clamp	
4.3.1	
4.3.2	
4.3.3	
4.4 Line End Clamp	
4.4.1	
4.4.2	
4.4.3	
4.4.4	
4.4.5	
4.5 Flexible Cable with terminations	
4.5.1	
4.5.2	
4.5.3	
Test & Inspection	
5.1	
5.2	
5.3	
5.4	
Marking & Instructions	
6.1	
6.2	
6.3	

.....
Supplier's Name, Signature, Stamp and Date

Issued by: Head of Section, Tech Stds & Specs

Authorized by: Head of Department , R & D

Signed:

Signed:

Date: 2012-05-30

Date: 2012-05-30

