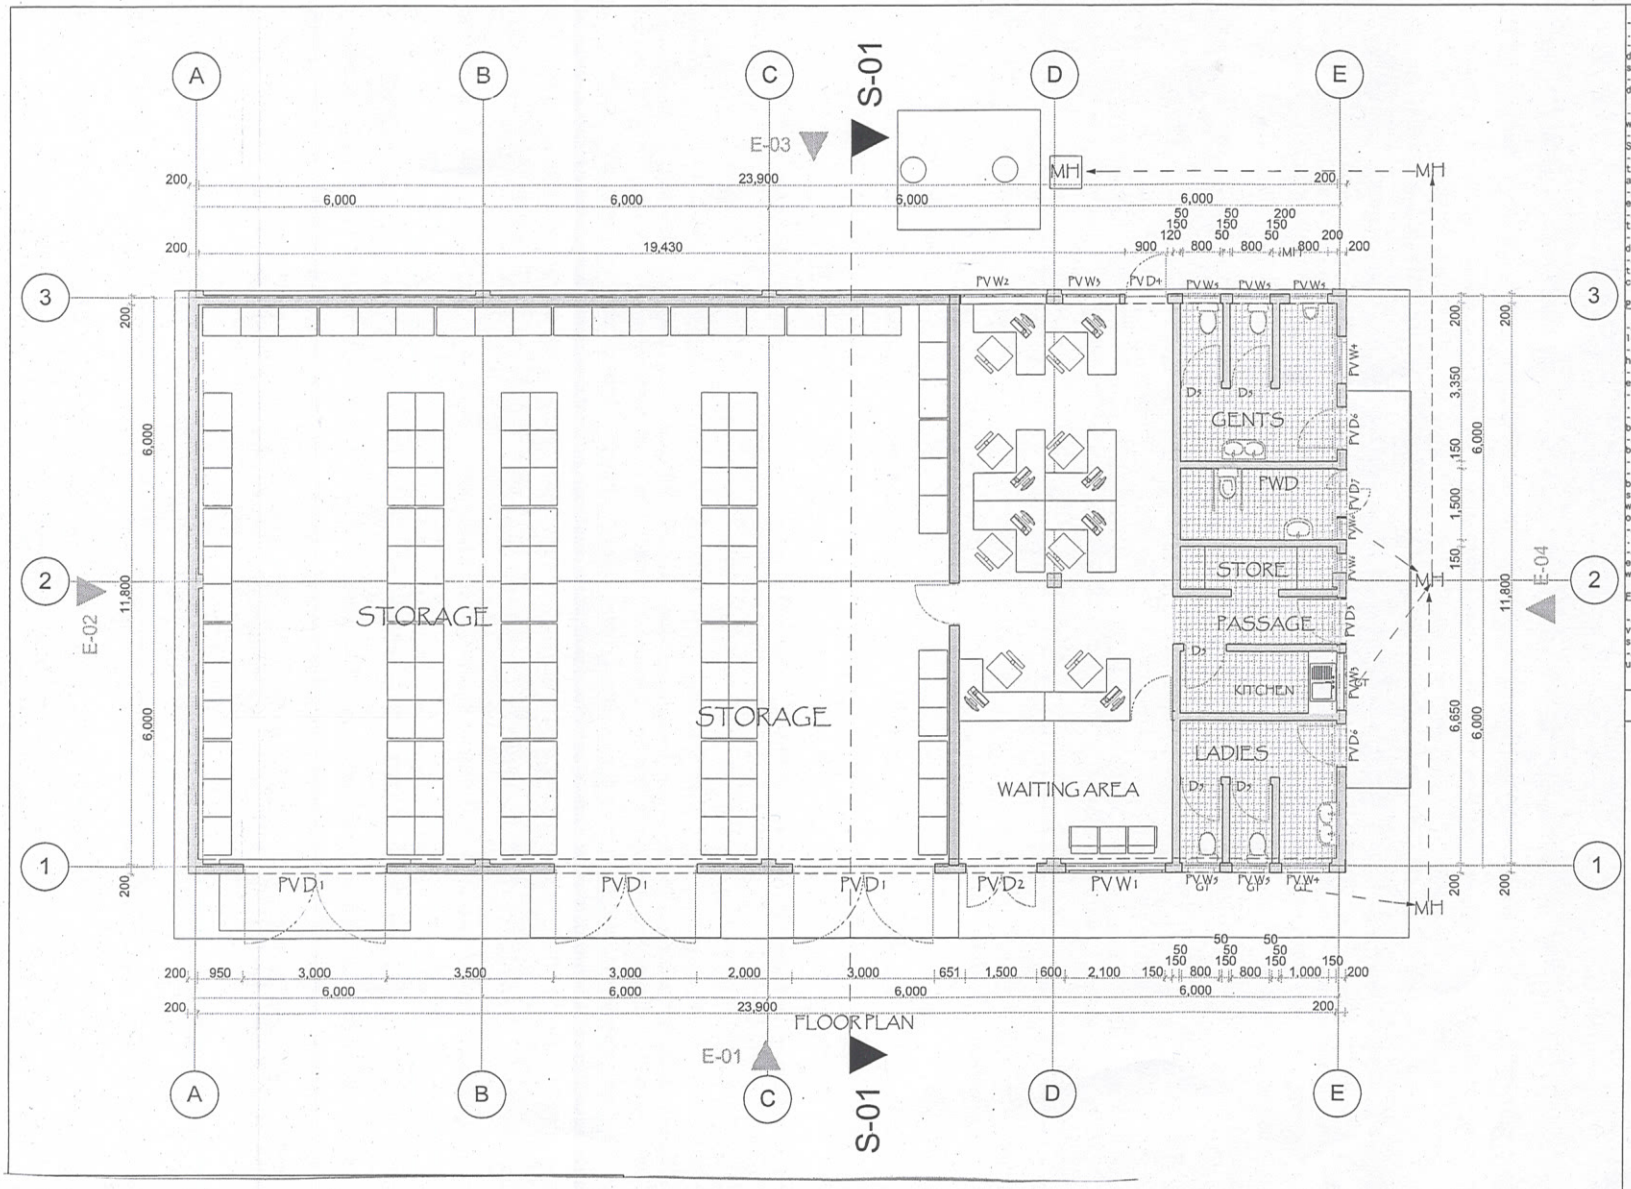

NOTES

- All dimenssions are in mm unless otherwise specified.
- Drawing are not to scalled, only figured dimensions should be used
- The contractor must check and verify all demension before commencement of any work.
- All walls less than 150mm thick to be reinforced with hoop iron at every alternate course.
- Depth of foundation to be detemined on site to S.E 's aproval
- All adjacent R.C . work and masonry walls to be tied with hoop iron at every alternate course.
- All openings to have Permanent Ventilations except Wc . & Sh.internal doors.
- All soil under slab around and under foundation to be poisoned for termite control.
- For all R.C work,refer to stuctural Engineer's details.
- All adjacent R.C . work and masonry walls to be tied with hoop iron at every alternate course.

PLUMBING

- All plumbing and drainage to comply with relevant local authority
- SVP denotes soil vent pipe to be provided at the head of the drainage system
- Drains pass beneath buildings & driveways to be encased in 150mm concrete surround.
- The storm drain pipes to comply with BS 556 specification.
- All underground foul and waste drain pipes shall be uPVC to comply with BS 5255.
- All inspection chambers covers and framing shall be cast iron.
- Minimum slope in the drains pipes to be 1 in 100
- No chases will be allowed for pipes. Sleeves will be allowed with written approval of structural Eng's. No cutting of concrete without express approval of the Architect or structural Eng
- All testing of pipes must be completed before plastering.
- All mechnical works must be co-odinated with electrical and any conflict must be clarified be work begin.

FINISHES

- All doors and windows to have parmanent vsentilations (PV) exceptw .c's and showers doors.
- All floor finishes to be cement/sand screed unless otherwise indicated

WINDOW& DOOR SCHEDULE

WINDOW SCHEDULE

STEEL CASEMENT

ITEM	W	H	NO
W1	2,100	1,800	01
W2	1,800	1,800	01
W3	1,200	1,800	02
W4	1,000	1,200	02
W5	800	1,200	05
W6	400	1,200	02
GRILL			
W7	5,700	1,000	08

DOOR SCHEDULE

METAL DOOR SLIDING

ITEM	W	H	NO
D1	3,000	3,000	03
D2	900	2,700	01

METAL DOOR

ITEM	W	H	NO
D3	1,000	2,400	01

STEEL FIRE DOOR

ITEM	W	H	NO
D4	900	2,100	1

WOODEN

ITEM	W	H	NO
D5	900	2,100	05
D6	900	2,400	02
D7	1,000	2,400	01

Proposed construction of a Go-down

Location: Machakos Substation Yard
Plot No.....

REF	REV	DATE	SIGN

Kenya Power

DRAWING NO; 01

KENYA POWER

Scale 1:100

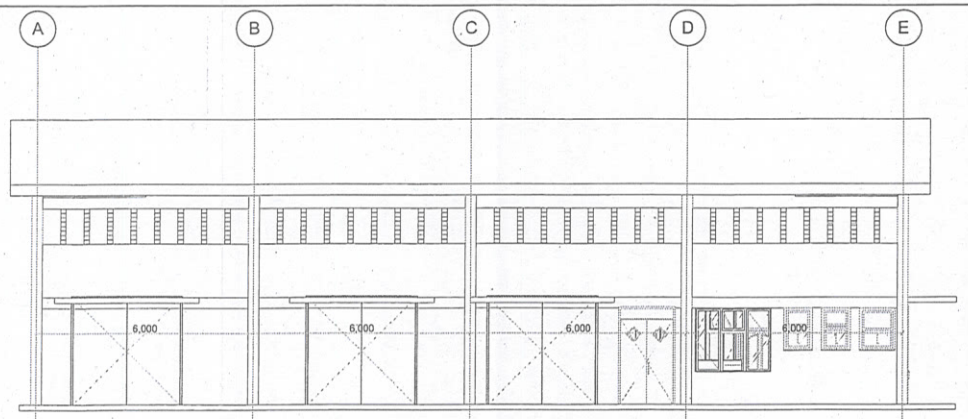

ELEVATION E-01

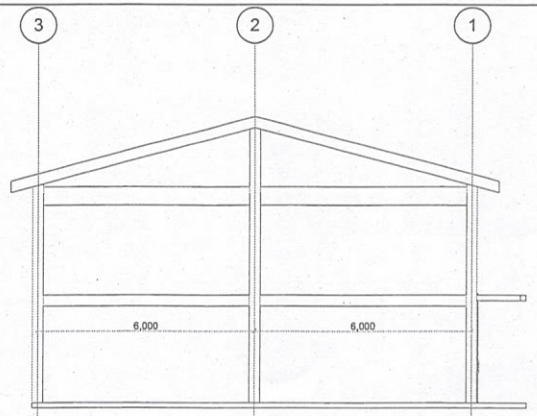

ELEVATION E-02

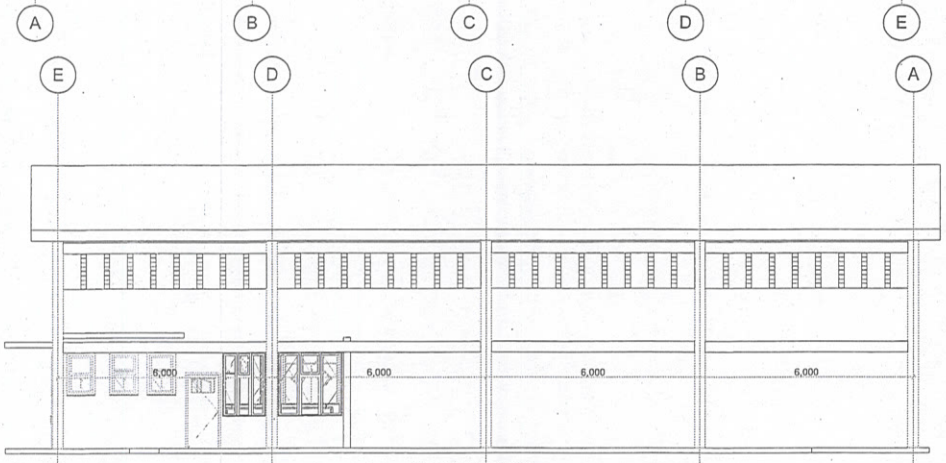

ELEVATION E-03

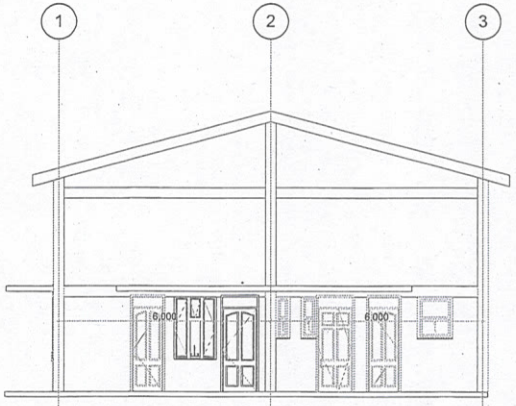

ELEVATION E-04

NOTES

- All dimenssions are in mm unless otherwise specified.
- Drawing are not to scalled, only figured dimensions should be used
-The contractor must check and verify all demension before commencement of any work.
-All walls less than 150mm thick to be reinforced with hoop iron at every alternate course.
-Depth of foundation to be detemined on site to S.E 's aproval
-All adjacent R.C . work and masonry walls to be tied with hoop iron at every alternate course.
-All openings to have Permanent Ventilations except Wc . & Sh.internal doors.
-All soil under slab around and under foundation to be poisoned for termite control.
-For all R.C work,refer to stuctural Engineer's details.
-All adjacent R.C . work and masonry walls to be tied with hoop iron at every alternate course.

PLUMBING

-All plumbing and drainage to comply with relevant local authority
-SVP denotes soil vent pipe to be provided at the head of the drainage system
-Drains pass beneath buildings & driveways to be encased in 150mm concrete surround.
-The storm drain pipes to comply with BS 556 specification.
-All underground foul and waste drain pipes shall be uPVC to comply with BS 5255.
-All inspection chambers covers and framing shall be cast iron.
-Minimum slope in the drains pipes to be 1 in 100
-No chases will be allowed for pipes. Sleeves will be allowed with written approval of structural Eng's. No cutting of concrete without express approval of the Architect or structural Eng
-All testing of pipes must be completed before plastering.
-All mechnical works must be co-odinated with electrical and any conflict must be clarified be work begin.

FINISHES

-All doors and windows to have parmanent vsentilations (PV) exceptw .c's and showers doors.
-All floor finishes to be cement/sand screed unless otherwise indicated

Remarks	Sign	Date	Approved

REGIONAL SIGN OFF			
	DESIGNATION	SIGN	DATE
APPROVED BY	REGIONAL MANAGER NAIROBI		
RECOMMENDED BY	COUNTY BUSINESS MANAGER MACHAKOS		
CHECKED BY	CHIEF HR& ADMIN NAIROBI		
CHECKED BY	SUPPLY CHAIN OFFICER MACHAKOS		
CHECKED BY	SNR BUILDING TECHNICIAN NAIROBI		

CENTRAL OFFICE SIGN OFF		DATE	SIGN
	DESIGNATION		
APPROVED BY	AG. MANAGER SUPPLY CHAIN (L)		
RECOMMENDED BY	MANAGER ADMIN& PROPERTY		
CHECKED BY	PRINCIPAL PROJECTS OFFICER		
DRAWN BY	ROGERS MWENDA		

Proposed construction of a Go-down

Location: Machakos Substation Yard
Plot No.....

REF	REV	DATE	SIGN

Kenya Power

DRAWING NO; 01

KENYA POWER

Scale 1:100

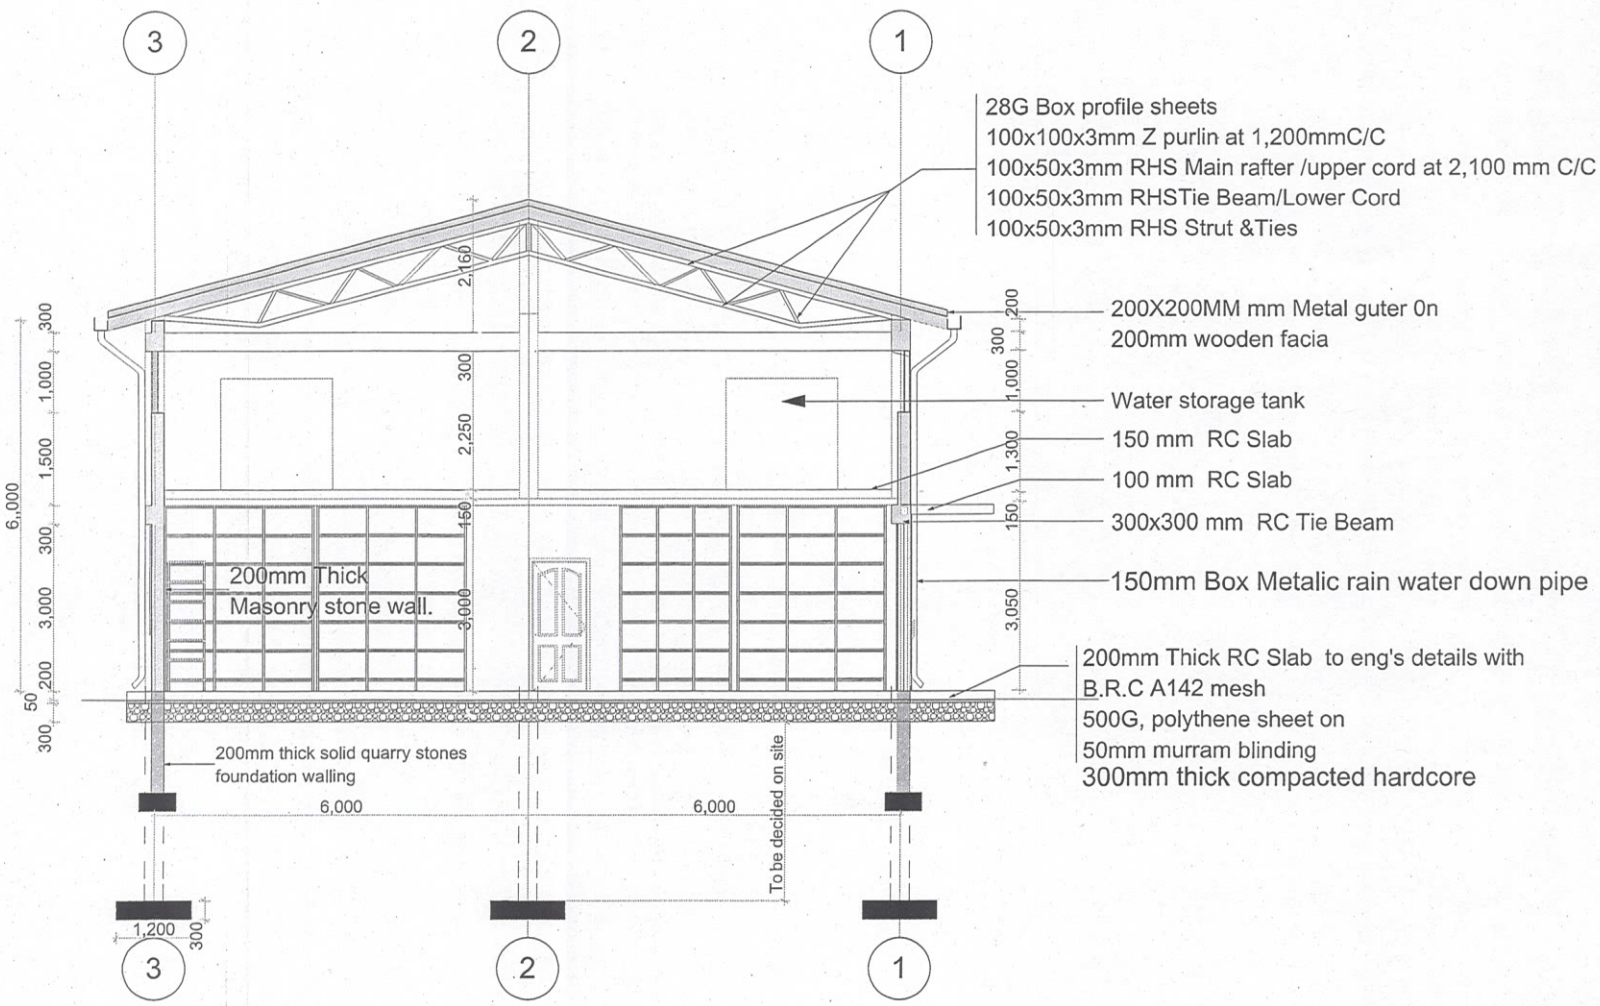

NOTES

- All dimenssions are in mm unless otherwise specified.
- Drawing are not to scalled, only figured dimensions should be used
-The contractor must check and verify all demension before commencement of any work.
-All walls less than 150mm thick to be reinforced with hoop iron at every alternate course.
-Depth of foundation to be detemined on site to S.E 's aproval
-All adjacent R.C . work and masonry walls to be tied with hoop iron at every alternate course.
-All openings to have Permanent Ventilations except Wc . & Sh.internal doors.
-All soil under slab around and under foundation to be poisoned for termite control.
-For all R.C work,refer to stuctural Engineer's details.
-All adjacent R.C . work and masonry walls to be tied with hoop iron at every alternate course.

PLUMBING

-All plumbing and drainage to comply with relevant local authority
-SVP denotes soil vent pipe to be provided at the head of the drainage system
-Drains pass beneath buildings & driveways to be encased in 150mm concrete surround.
-The storm drain pipes to comply with BS 556 specification.
-All underground foul and waste drain pipes shall be uPVC to comply with BS 5255.
-All inspection chambers covers and framing shall be cast iron.
-Minimum slope in the drains pipes to be 1 in 100
-No chases will be allowed for pipes. Sleeves will be allowed with written approval of structural Eng's. No cutting of concrete without express approval of the Architect or structural Eng
-All testing of pipes must be completed before plastering.
-All mechnical works must be co-odinated with electrical and any conflict must be clarified be work begin.

FINISHES

-All doors and windows to have parmanent vsentilations (PV) exceptw .c's and showers doors.
-All floor finishes to be cement/sand screed unless otherwise indicated

Remarks	Sign	Date	Approved

	REF	REV	DATE	SIGN		
Proposed construction of a Go-down					Kenya Power	DRAWING NO; 01
Location: Machakos Substation Yard Plot No.....						KENYA POWER
						Scale 1:100

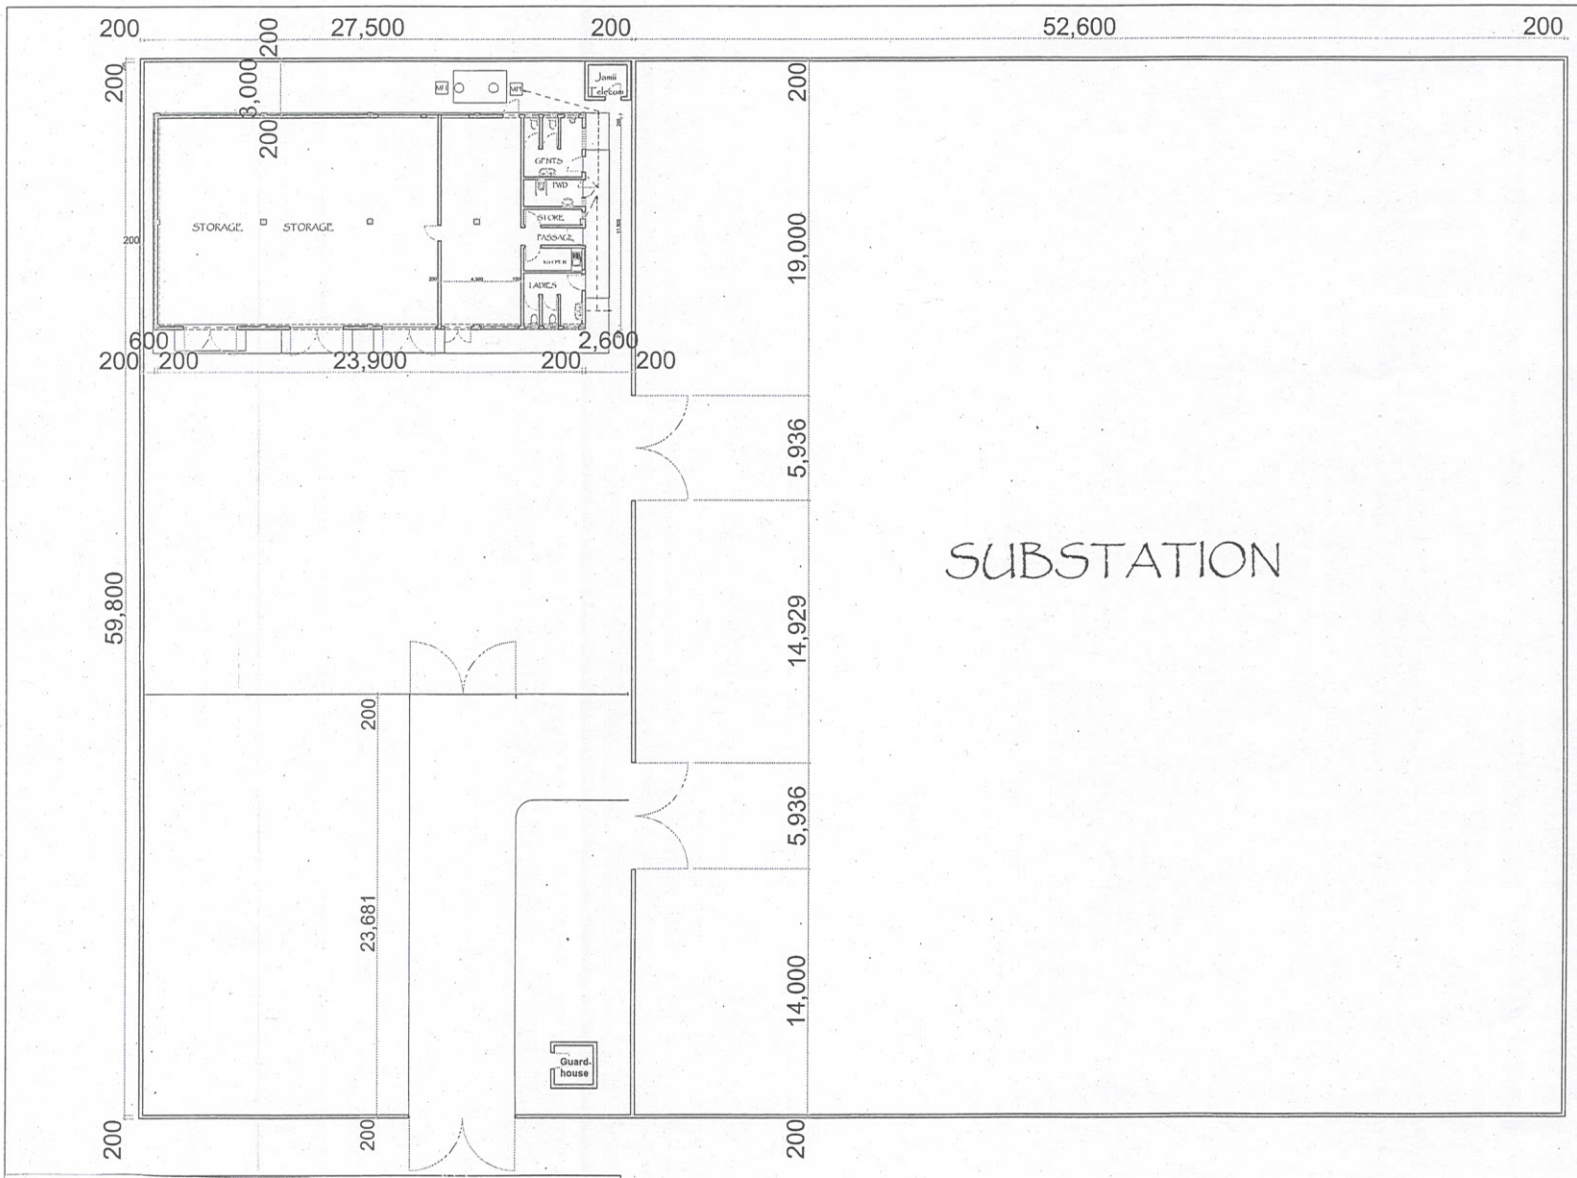

NOTES

- All dimenssions are in mm unless otherwise specified.
- Drawing are not to scalled, only figured dimensions should be used
- The contractor must check and verify all demension before commencement of any work.
- All walls less than 150mm thick to be reinforced with hoop iron at every alternate course.
- Depth of foundation to be detemined on site to S.E 's aproval
- All adjacent R.C . work and masonry walls to be tied with hoop iron at every alternate course.
- All openings to have Permanent Ventilations except Wc . & Sh.internal doors.
- All soil under slab around and under foundation to be poisoned for termite control.
- For all R.C work,refer to stuctural Engineer's details.
- All adjacent R.C . work and masonry walls to be tied with hoop iron at every alternate course.

PLUMBING

- All plumbing and drainage to comply with relevant local authority
- SVP denotes soil vent pipe to be provided at the head of the drainage system
- Drains pass beneath buildings & driveways to be encased in 150mm concrete surround.
- The storm drain pipes to comply with BS 556 specification.
- All underground foul and waste drain pipes shall be uPVC to comply with BS 5255.
- All inspection chambers covers and framing shall be cast iron.
- Minimum slope in the drains pipes to be 1 in 100
- No chases will be allowed for pipes. Sleeves will be allowed with written approval of structural Eng's. No cutting of concrete without express approval of the Architect or structural Eng
- All testing of pipes must be completed before plastering.
- All mechnical works must be co-odinated with electrical and any conflict must be clarified be work begin.

FINISHES

- All doors and windows to have parmanent vsentilations (PV) exceptw .c's and showers doors.
- All floor finishes to be cement/sand screed unless otherwise indicated

WINDOW SCHEDULE

STEEL CASEMENT			
ITEM	W	H	NO
W1	2,100	1,800	01
W2	1,800	1,800	01
W3	1,200	1,800	02
W4	1,000	1,200	02
W5	800	1,200	05
W6	400	1,200	02
GRILL			
W7	5,700	1,000	08

DOOR SCHEDULE

METAL DOOR SLIDING			
ITEM	W	H	NO
D1	3,000	3,000	03
D2	900	2,700	01

METAL DOOR			
ITEM	W	H	NO
D3	1,000	2,400	01

STEEL FIRE DOOR			
ITEM	W	H	NO
D4	900	2,100	1

WOODEN

ITEM	W	H	NO
D5	900	2,100	05
D6	900	2,400	02
D7	1,000	2,400	01

Proposed construction of a Go-down

Location: Machakos Substation Yard
Plot No.....

REF	REV	DATE	SIGN

Kenya Power

DRAWING NO; 01

KENYA POWER

Scale 1:100

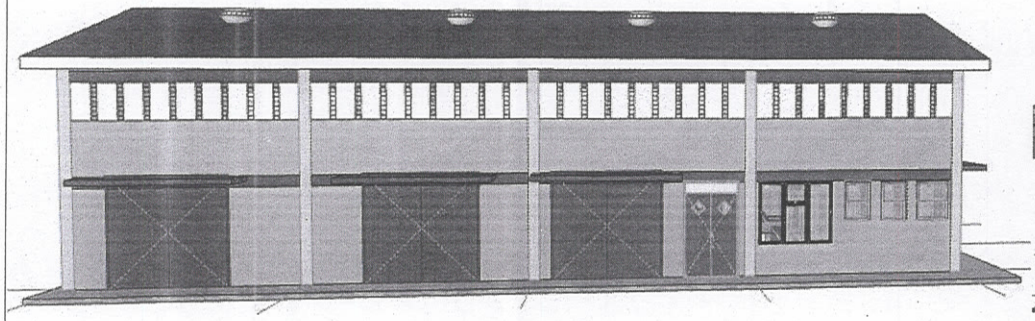

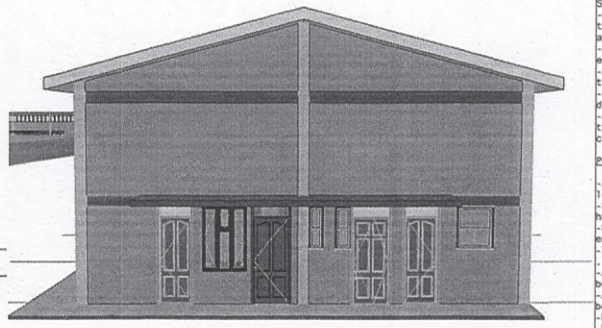

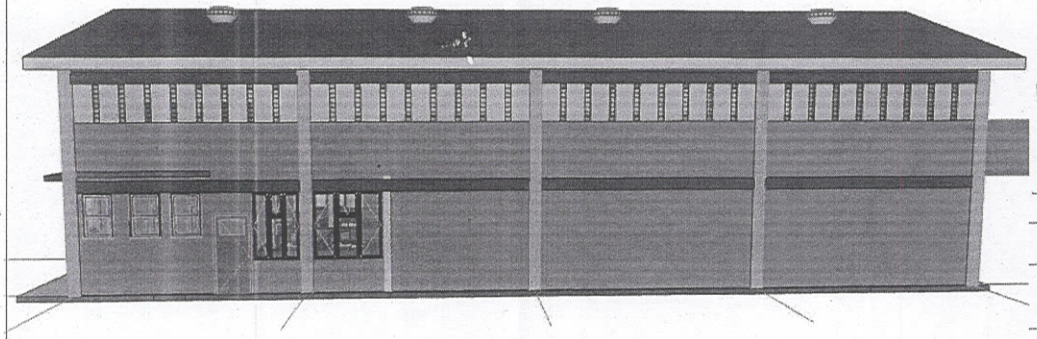

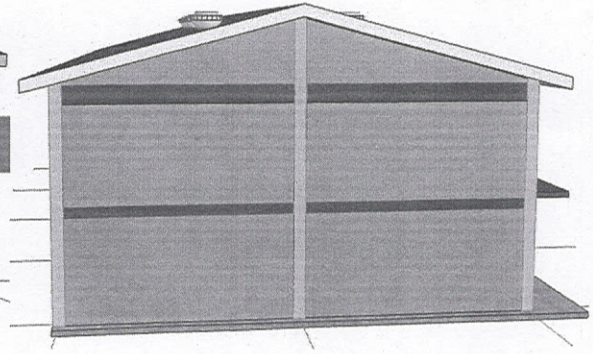

NOTES

- All dimenssions are in mm unless otherwise specified.
- Drawing are not to scalled, only figured dimensions should be used
-The contractor must check and verify all demension before commencement of any work.
-All walls less than 150mm thick to be reinforced with hoop iron at every alternate course.
-Depth of foundation to be detemined on site to S.E 's aproval
-All adjacent R.C . work and masonry walls to be tied with hoop iron at every alternate course.
-All openings to have Permanent Ventilations except Wc . & Sh.internal doors.
-All soil under slab around and under foundation to be poisoned for termite control.
-For all R.C work,refer to stuctural Engineer's details.
-All adjacent R.C . work and masonry walls to be tied with hoop iron at every alternate course.

PLUMBING

-All plumbing and drainage to comply with relevant local authority
-SVP denotes soil vent pipe to be provided at the head of the drainage system
-Drains pass beneath buildings & driveways to be encased in 150mm concrete surround.
-The storm drain pipes to comply with BS 556 specification.
-All underground foul and waste drain pipes shall be uPVC to comply with BS 5255.
-All inspection chambers covers and framing shall be cast iron.
-Minimum slope in the drains pipes to be 1 in 100
-No chases will be allowed for pipes. Sleeves will be allowed with written approval of structural Eng's. No cutting of concrete without express approval of the Architect or structural Eng
-All testing of pipes must be completed before plastering.
-All mechnical works must be co-odinated with electrical and any conflict must be clarified be work begin.

FINISHES

-All doors and windows to have parmanent vsentilations (PV) exceptw .c's and showers doors.
-All floor finishes to be cement/sand screed unless otherwise indicated

WINDOW SCHEDULE

STEEL CASEMENT			
ITEM	W	H	NO
W1	2,100	1,800	01
W2	1,800	1,800	01
W3	1,200	1,800	02
W4	1,000	1,200	02
W5	800	1,200	05
W6	400	1,200	02
GRILL			
W7	5,700	1,000	08

DOOR SCHEDULE

METAL DOOR SLIDING			
ITEM	W	H	NO
D1	3,000	3,000	03
D2	900	2,700	01
METAL DOOR			
ITEM	W	H	NO
D3	1,000	2,400	01
STEEL FIRE DOOR			
ITEM	W	H	NO
D4	900	2,100	1
WOODEN			
ITEM	W	H	NO
D5	900	2,100	05
D6	900	2,400	02
D7	1,000	2,400	01

Proposed construction of a Go-down

Location: Machakos Substation Yard
Plot No.....

REF	REV	DATE	SIGN

Kenya Power

DRAWING NO; 01

KENYA POWER

Scale 1:100